



FNAME

REVDATE

USER

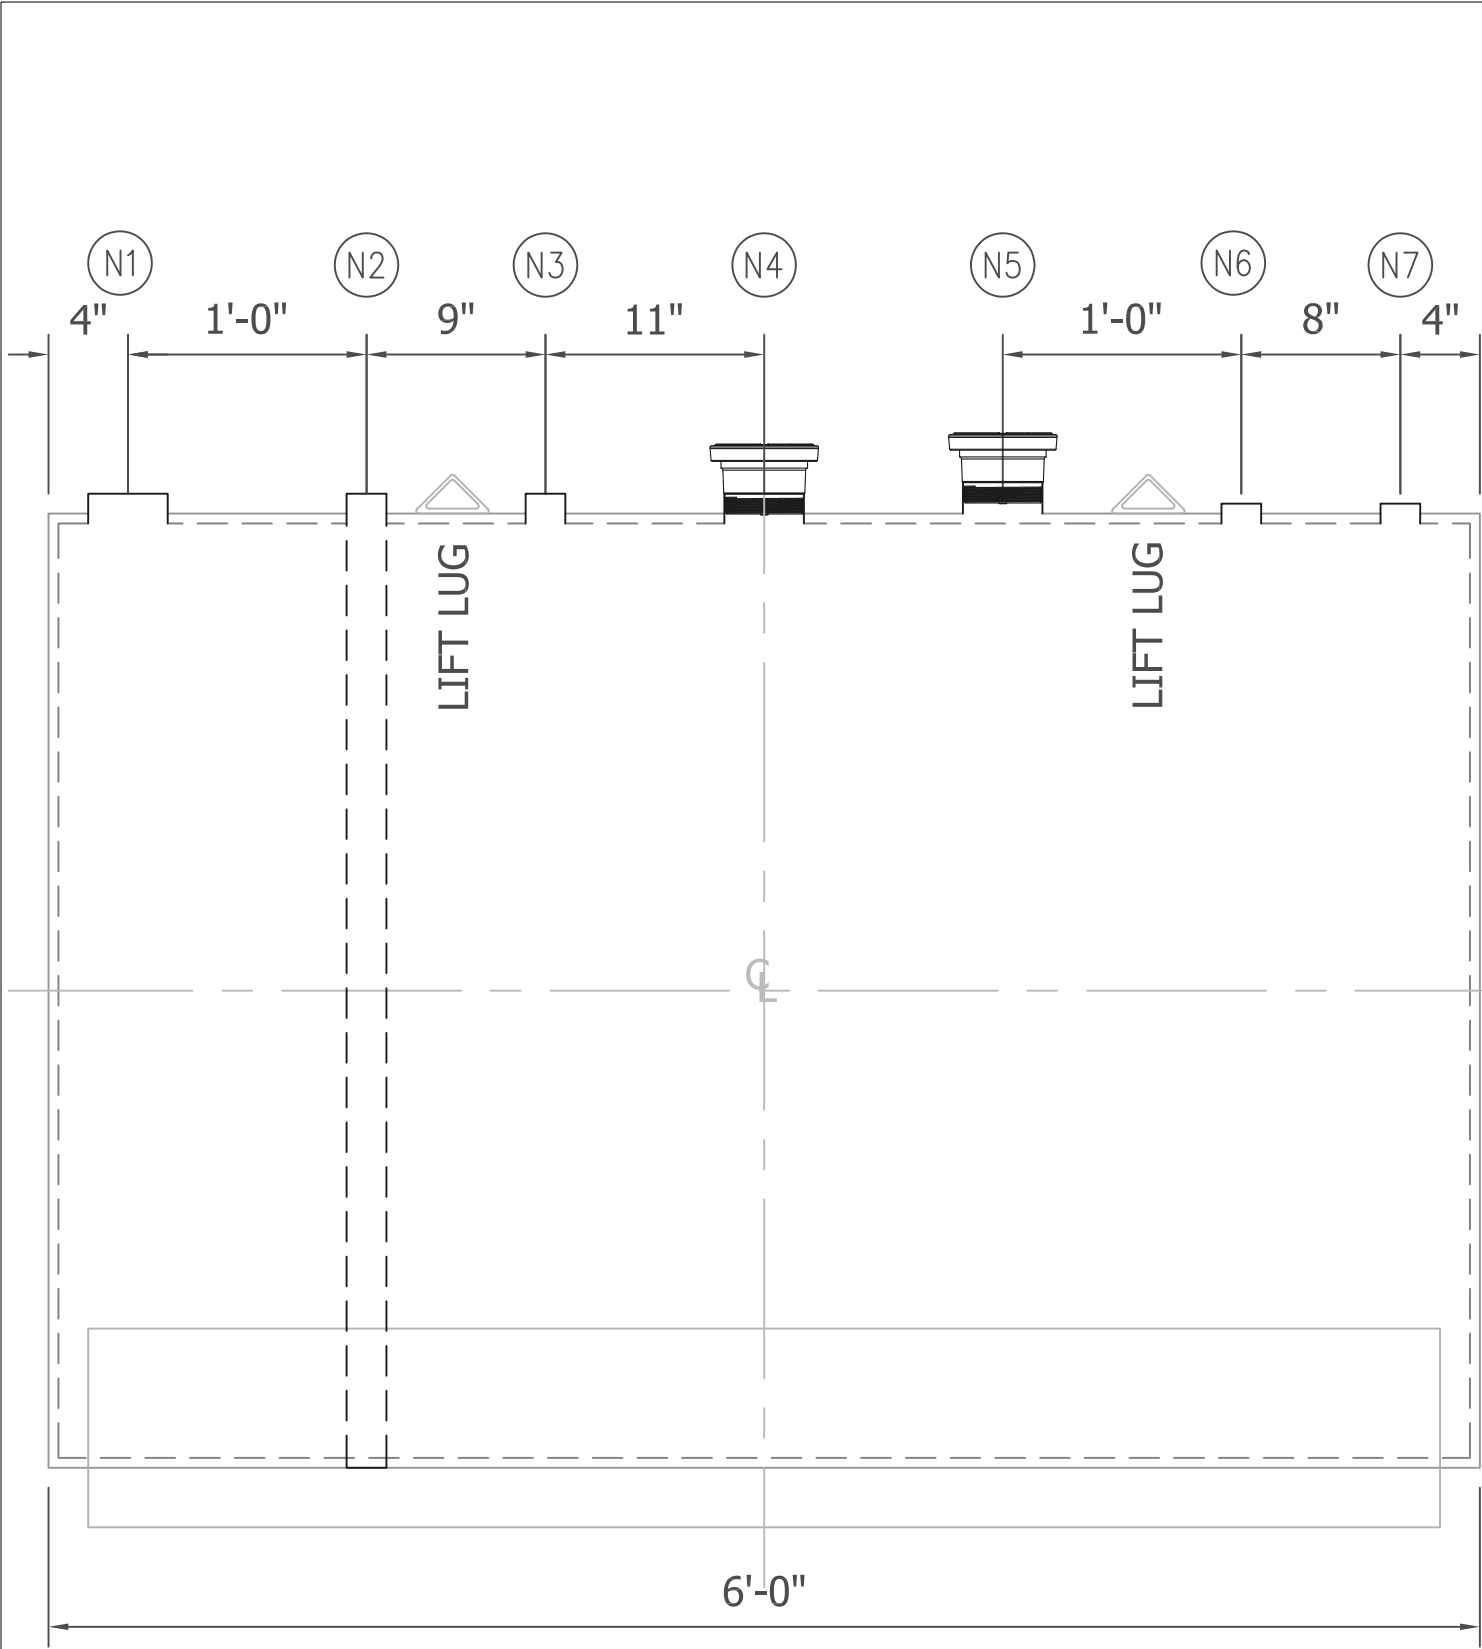

SIDE ELEVATION

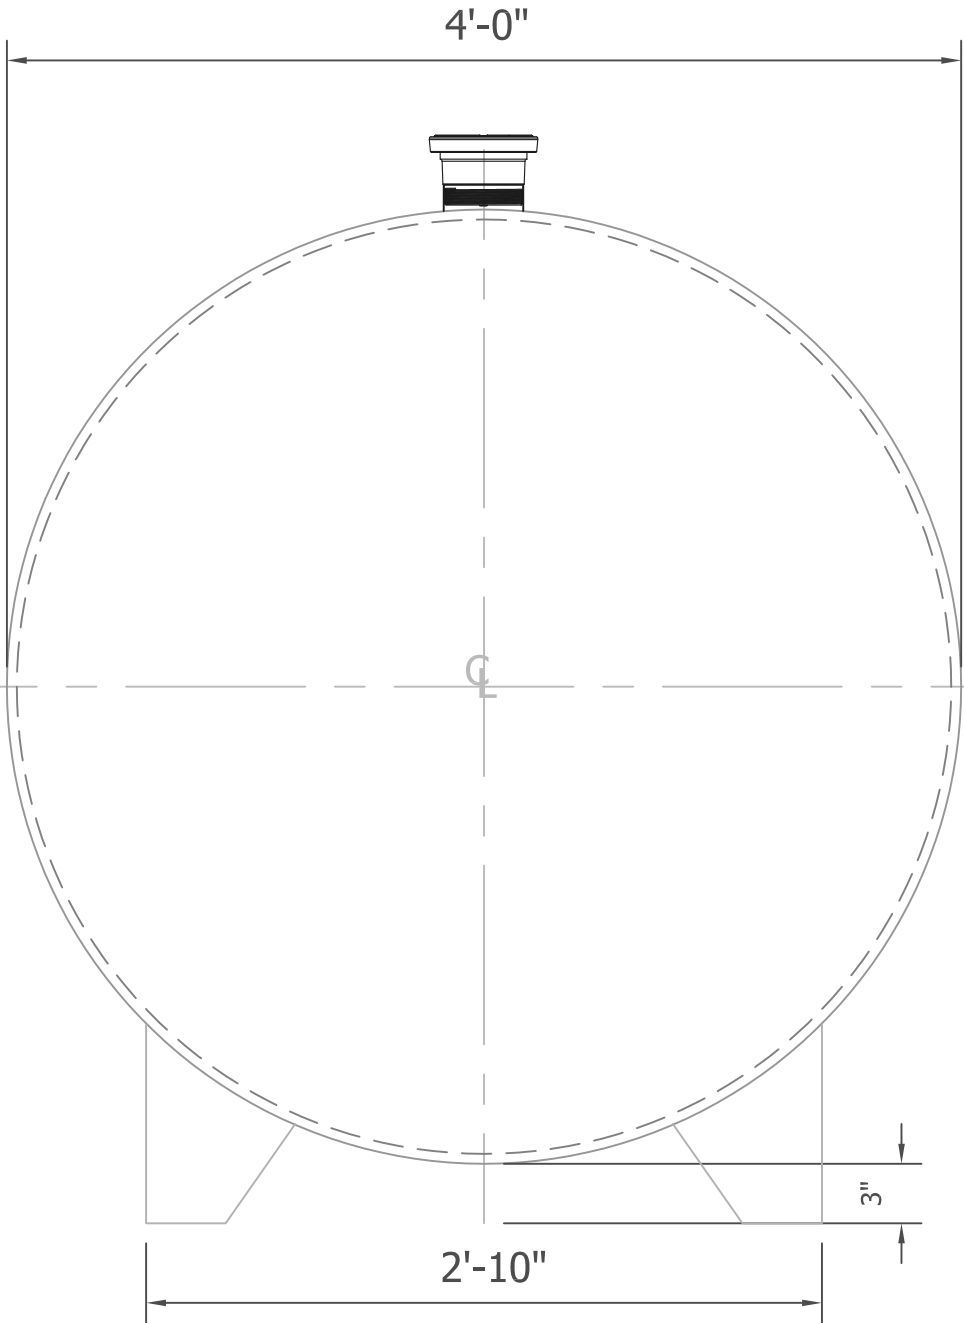

END ELEVATION

GENERAL SPECIFICATIONS	
1.	ORDER QUANTITY: 1 TANK
2.	NOMINAL CAPACITY: 550 GALLONS
3.	VESSEL OPERATING PRESSURE: ATMOSPHERIC
4.	VESSEL OPERATING TEMPERATURE: AMBIENT
5.	CONSTRUCTION: DOUBLE-WELDED BUTT JOINT
6.	MATERIAL: MILD CARBON STEEL
7.	TEST: PER UL142, SWRI
8.	APPROVED LABELS: UL142, STI FLAMESHIELD
9.	EXTERIOR COATING: SANDBLAST AND PAINT DTM WHITE ENAMEL
10.	TANK ACCESSORIES TO BE PROVIDED AND INSTALLED BY OTHERS (UNLESS NOTED ELSEWHERE)

GENERAL DIMENSIONS			
CAPACITY	DIAMETER	LENGTH	WEIGHT
550 GAL	4'	6'-0"	900 LBS

GAUGE/THICKNESS			
OUTER HEAD	OUTER SHELL	INNER HEAD	INNER SHELL
12 GA	12 GA	12 GA	12 GA

FITTING DETAIL			
TAG NO.	DESCRIPTION	LOCATION	NOZZLE SIZE
N1	FILL	TOP	4" FNPT
N2	INTERSTITIAL GAUGE	TOP	2" FNPT
N3	GAUGE	TOP	2" FNPT
N4	EMERGENCY VENT	TOP	4" FNPT
N5	EMERGENCY VENT	TOP	4" FNPT
N6	NORMAL VENT	TOP	2" FNPT
N7	DISPENSE	TOP	2" FNPT

NO.	REVISION/ISSUE	DATE

CUSTOMER INFORMATION	
BHT320110	

DRAWN BY:	CRP	DRAWING NUMBER:	TANK #1
REVIEWED BY:	MEJ	DRAWING DATE:	03/14/14
SCALE:	NTS	QUOTE NUMBER:	BHT320110
CAD FILE NAME:			
550 GAL DW BHT320110.DWG			



Corporate Centre 200  
PO Box 160  
Marion, IA 52302-0160  
T 319.377.6357  
F 319.377.0075  
www.acterragroup.com  
info@acterragroup.com

DISCLAIMERS
THIS DRAWING IS THE PROPERTY OF ACTERRA GROUP, INC. AND IS SUBMITTED AS A CONFIDENTIAL DISCLOSURE. ALL RIGHTS TO REPRODUCE THIS DRAWING AND THE ARTICLES THEREIN ARE EXPRESSLY RESERVED. THIS DOCUMENT AND ITS CONTENTS SHALL BE CONSIDERED INTELLIGENT PROPERTY OF THE ACTERRA GROUP, INC., THEREFORE, THE USE OF THE DOCUMENT AND ITS CONTENTS ARE STRICTLY PROHIBITED WITHOUT THE WRITTEN APPROVAL OF THE ACTERRA GROUP, INC.. THE SIZES, DIMENSIONS, THICKNESS, ETC., ARE NOT INTENDED TO REPLACE OR REPRESENT NECESSARY ENGINEERING CALCULATIONS. THE SIZES, DIMENSIONS, THICKNESS, ETC., ARE NOT TO SUPERSEDE EXISTING TANK LAWS, REGULATIONS OR STANDARDS.

APPROVAL
CUSTOMER: _____
DATE: _____